

Wall Mount CO₂, Air Quality, RH & Temp Transmitter



Features

- Up to 3 analogue outputs, CO₂, AQ, RH or Temp.
- CO₂ Self-calibration algorithm
- LCD with real time measurements

Specification

Range's:

CO ₂	0 to 2000ppm
AQ	0 to 30ppm
RH	0 to 100%
Temp.	0 to 50°C

Output signals up to three (jumper selectable):

0-10Vdc, 4-20mA or Modbus

Modbus RS485 19200bps, 15KV antistatic protection

Power supply:

Voltage output 24Vac/dc, ±10%

Current output 24Vdc only, ±10%

Consumption Max, 3.5W Avg, 2.8W

Maximum current 146mA

Accuracy @ 25°C:

CO ₂	±50ppm +3% of reading
AQ	±10%
RH	<±3%RH
Temp.	±0.5°C

CO₂ Stability <2% of FS over sensor life

Sensor life 10 years, typical

Response time <2 minutes, for 90% step change

Stabilization time:

First time 2 Hours

Operational 2 Minutes

LCD display 3 colour, see page 2 for details

Environmental:

Operational:

Temp -10 to + 50°C

RH 0 to 95% non-condensing

Storage temp. -40 to +70°C

CE Conformity CE Marked

Housing:

Material ABS

Dimensions 130 x 85 x 36.5mm

Protection IP30

Country of origin China

Product Codes

GS-CO2-AQ-RHT-W

Carbon dioxide, air quality, humidity or temperature transmitter with current or voltage selectable outputs

GS-CO2-AQ-RHT-W-M

Carbon dioxide, air quality, humidity or temperature transmitter with current, voltage and Modus selectable outputs



Please Note:

Current versions are NOT loop powered and will require a common 0V connection.

Technical Overview

This innovative one housing solution for combined sensing of CO₂, Air Quality, RH and Temp measurement, offers long term high stability and accuracy for all measured parameters.

The air quality sensor is a mix gases sensor with high sensitivity for VOC such as ammonia, toluene, formaldehyde and cigarette smoke, alcohol, H₂S, and carbon monoxide.

The sensor can be used to ensure adequate ventilation while maximizing energy savings by ventilating at the optimum level, making these ideal for all types of ventilation in many applications.

Installation

1. Select a location on a wall of the controlled space which will give a representative sample of the prevailing room condition.

Avoid sitting the sensor in direct sunlight, near diffusers, steam sources rubbish bins and gas appliances.

2. Gently remove the front cover from the back plate. The front plate is removed by pressing the tab on the base of the sensor with a flat bladed screwdriver. Gently slant the screwdriver and this will separate the front cover from the back plate.
3. Using the base as a template mark the hole centres and fix to the wall with suitable screws. Alternatively the base plate can be mounted on to a conduit box or a standard recessed back box.
4. Feed cable through the knockout in the base of the housing and terminate the cores at the terminal block on the back plate. Install wiring into terminal blocks as required, and push excess wire back into wall or junction box.
5. Select output type, 4-20mA or 0-10Vdc. Do **not** adjust any of the potentiometers as this will void warranty.
6. Ensure that the supply voltage is within the specified tolerances.
7. Replace the front cover to the base plate until a click is heard.
8. Power the unit, a red light will flash for about 120 sec. This is situated at the bottom of the housing face cover. After the count down the analogue output will be activated.

Installation (continued)

9. Pre-commissioning checks can be made after 10 minutes. Full commissioning should not be carried out for at least 24 hours. This will enable the ABC Logic self calibration procedure to complete.
10. It is recommended that screened cable be used and that the screen should be earthed at the controller only. Care should be taken not to lay control signal wiring in close proximity to power or other cables which may produce significant electromagnetic noise.

ABC Logic Self-Calibration

When first powering the transmitter, it needs to be powered continuously for at least 24 hours. This will allow the CO₂ sensors ABC Logic self-calibration system operate correctly.

Display



The 3-colour backlit display shows all measured parameters and depending on the real time levels of CO₂ and VOC's the display will change colour when above the default set points.

Green	CO ₂	<1000ppm (optimal air quality)
	VOC	<10ppm (low pollution)
Yellow	CO ₂	>1000ppm (moderate air quality)
	VOC	>10ppm (medium pollution)
Red	CO ₂	>1400ppm (poor air quality)
	VOC	>20ppm (heavy pollution)

Jumpers

Output signal type

0-10Vdc (default):

J1 

J2 

J3 

4-20mA:


J1 

J2 

J3 



S1 S2 S3 S4 S5 S6



S1 S2 S3 S4 S5 S6

Humidity or temperature output for OUT3

Humidity (default):


J5 

Temperature:

J5 

Output 3 selection


Voltage/Current output selection

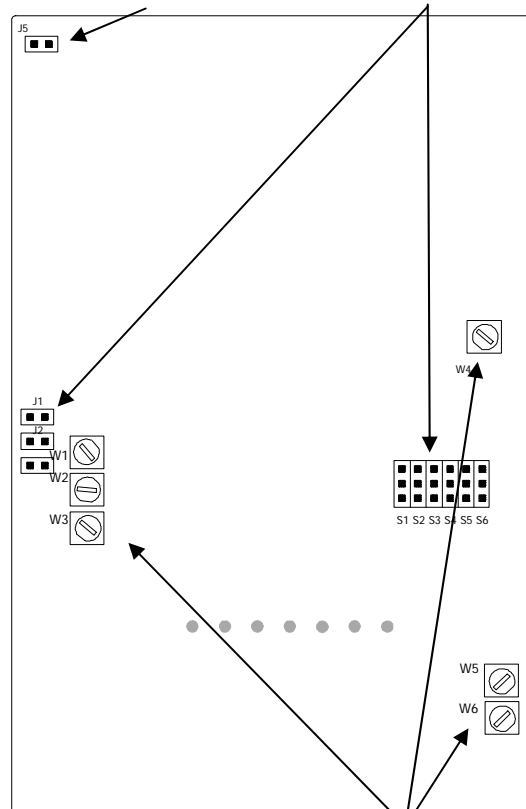

Do NOT adjust

Connections

(back plate)

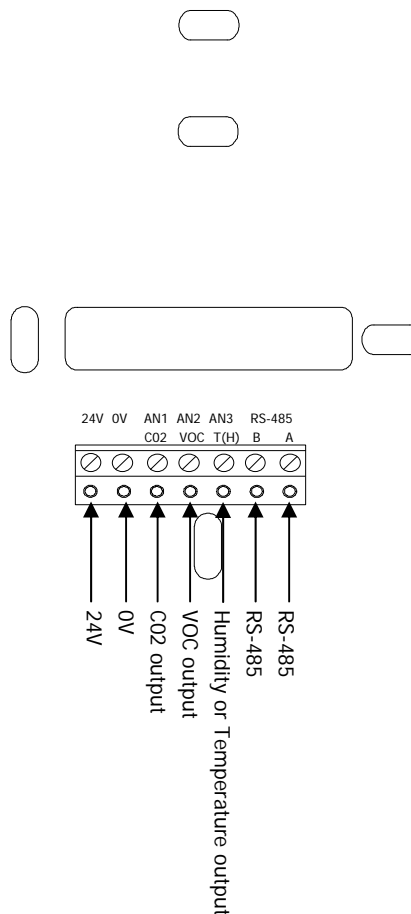

Note:

Voltage output

This can be supplied with 24Vac/dc.

Current output

If using in current output mode, the sensor must only be used with a 24Vdc supply. The sensor may be damaged if supplied with AC.

When using current output mode they are **NOT** loop powered and will require a common 0V connection.

Trend Scaling

IQ1xx and early IQ2x series (without type 5, characterise)

0-10Vdc	4-20mA
(0 to 2000ppm, CO ₂)	
Brange: -2000	Brange: -3000
Trange: 2000	Trange: 2000
Upper: 2000	Upper: 2000
Lower: 0	Lower: 0
Exponent: 4	Exponent: 4

0-10Vdc	4-20mA
(0 to 30%, VOC)	
Brange -30	Brange -45
Trange 300	Trange 30
Upper 30	Upper 30
Lower 0	Lower 0
Exp 2	Exp 2

0-10Vdc	4-20mA
(0 to 100%, RH)	
Brange -100	Brange -150
Trange 100	Trange 100
Upper 100	Upper 100
Lower 0	Lower 0
Exp 3	Exp 3

0-10Vdc	4-20mA
(0 to +50°C)	
Brange -50	Brange -75
Trange 50	Trange 50
Upper 50	Upper 50
Lower 0	Lower 0
Exp 3	Exp 3

Trend Scaling (continued)

Later IQ2x series and IQ3 (with type 5, characterise)

0-10Vdc	4-20mA
(0 to 2000ppm, CO ₂)	
Upper: 2000	Upper: 2000
Lower: 0	Lower: 0
Exponent: 4	Exponent: 4
Points Used: 2	Points Used: 2
I1: 0	I1: 4
O1: 0	O1: 0
I2: 10	I2: 20
O2: 2000	O2: 2000

0-10Vdc	4-20mA
(0 to 30%, VOC)	
Upper 30	Upper 30
Lower 0	Lower 0
Exp 2	Exp 2
Points used 2	Points used 2
I1 0	I1 4
O1 0	O1 0
I2 10	I2 20
O2 30	O2 30

0-10Vdc	4-20mA
(0 to 100%, RH)	
Upper 100	Upper 100
Lower 0	Lower 0
Exp 3	Exp 3
Points used 2	Points used 2
I1 0	I1 4
O1 0	O1 0
I2 10	I2 20
O2 100	O2 100

0-10Vdc	4-20mA
(-10 to 50°C)	
Upper: 50	Upper: 50
Lower: -10	Lower: -10
Exponent: 3	Exponent: 3
Points Used: 2	Points Used: 2
I1: 0	I1: 4
O1: -10	O1: -10
I2: 10	I2: 20
O2: 50	O2: 50